

**THERMAL CALCULATION**  
**Based on the building thermal imaging results,**  
**dated 05 March 2013.**

### Introduction

---

1. Any inquiries, related to this thermal calculation, shall be forwarded to OOO Teplozashchita, telephone (844) 331-39-50, [www.teploza.ru](http://www.teploza.ru), [teploza@mail.ru](mailto:teploza@mail.ru).

2. **Region**                      *Sergiyev Posad,  
prospect Krasnoi Armii, 234, building 3,  
Moscow Oblast.*

3. **Object**

*Residential apartment block thermal insulation.*


*Phase 1 – building thermal imaging prior to insulation application.*

### 4. Input data



$t_B$	Rated indoor air temperature	21°C
$t_{on}$	Average temperature of the heating period (SNiP 23-01-99, table 1)	minus 3.1 °C
$t_H$	Average temperature of the coldest five-day period (SNiP 23-01-99, table 1)	minus 27 °C
$t_H$	Ambient air temperature at time of thermal imaging	minus 20 °C

### Enclosing structure design.

---

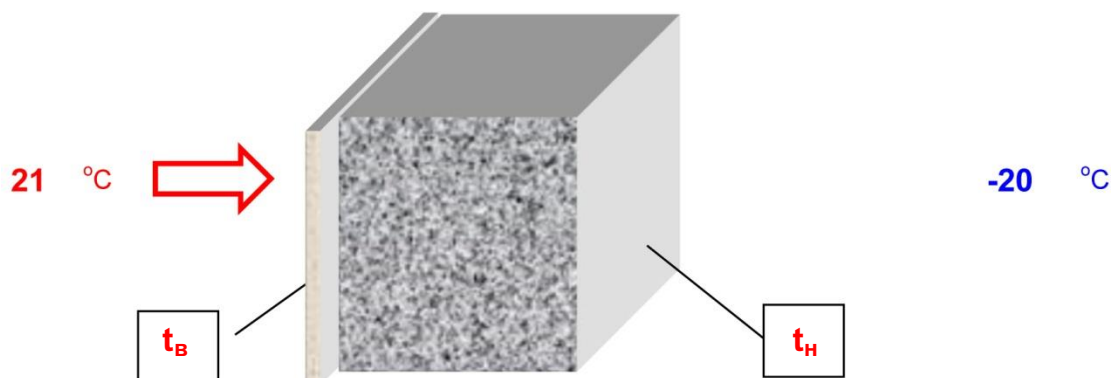


## Thermal imaging survey layout.

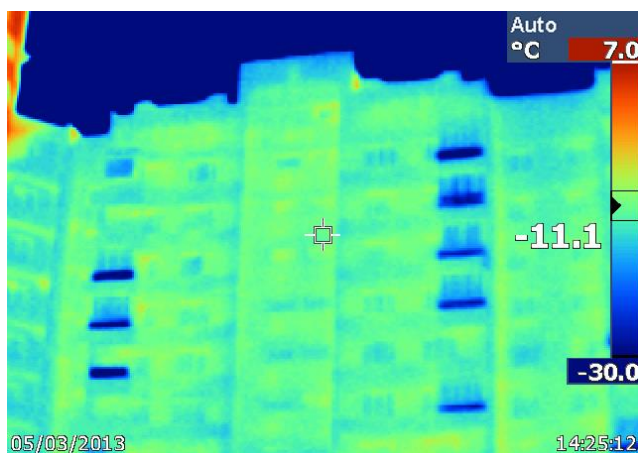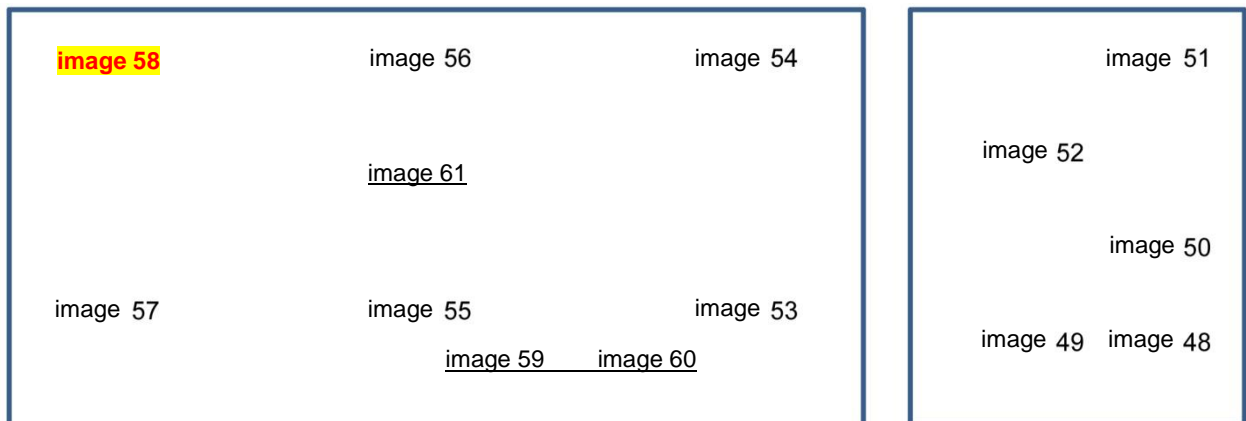


**Image 58**

Surface temperature in the measurement point: minus **11.1** ° C.

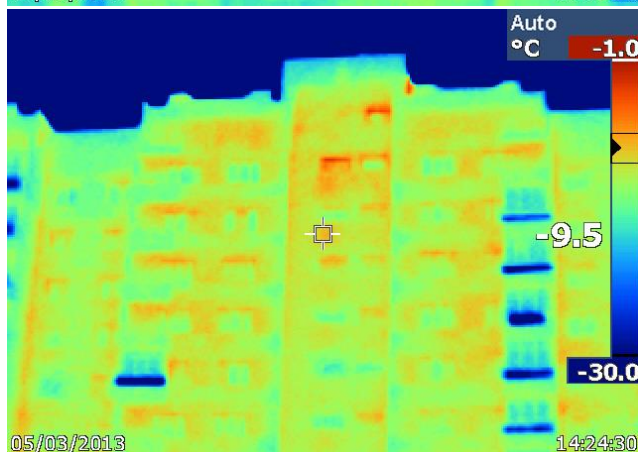

**Image 56**

Surface temperature in the measurement point: **minus 9.5** °C.

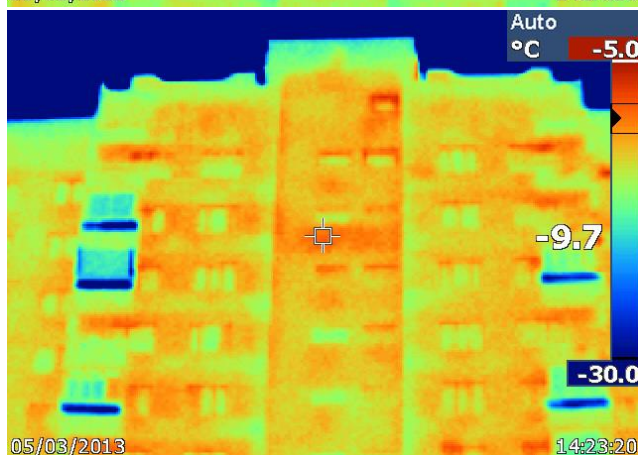


**Image 54**

Surface temperature in the measurement point: **minus 9.7** °C.




**Image 61**

Surface temperature in the measurement point: **minus 4.8 °C**

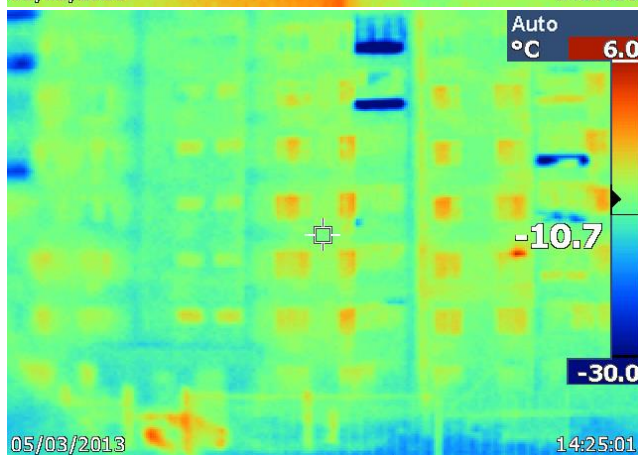


**Image 57**

Surface temperature in the measurement point: **minus 10.7 °C.**

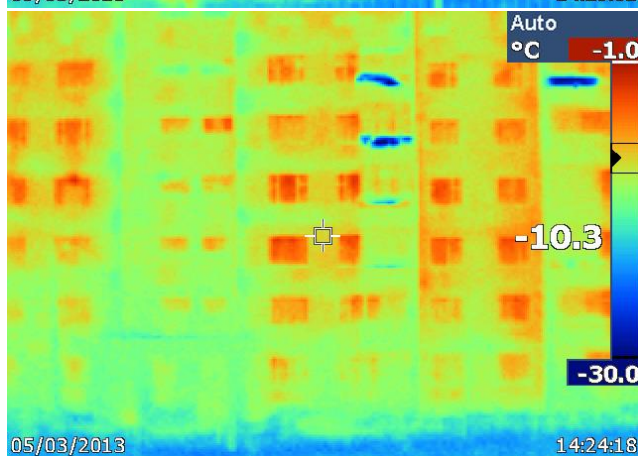

**Image 55**


Surface temperature in the measurement point: **minus 10.3 °C.**

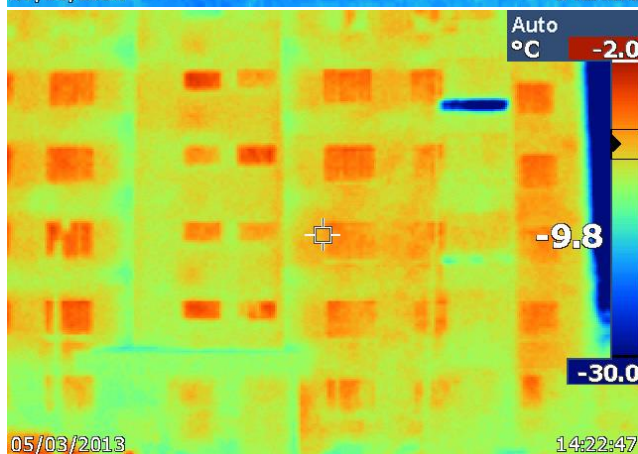

**Image 53**

Surface temperature in the measurement point: **minus 9.8 °C.**



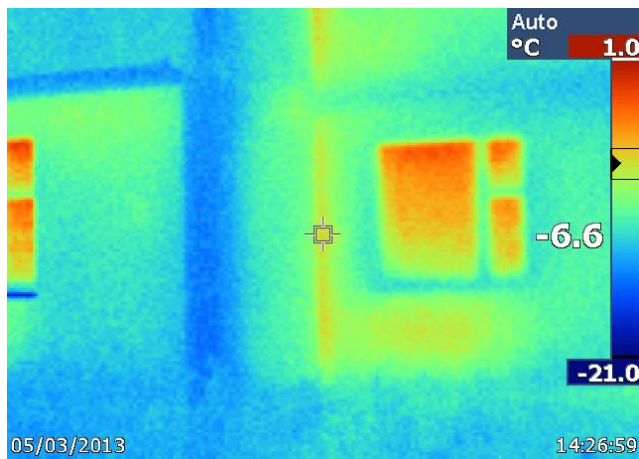


**Image 59**

Surface temperature in the measurement point: **minus 6.6 °C**.




**Image 60**

Surface temperature in the measurement point: **minus 4.8 °C**.

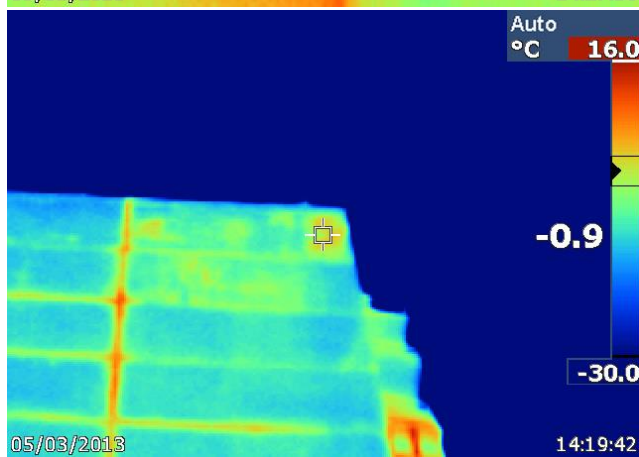


**Image 51**

Surface temperature in the measurement point: **minus 0.9 °C**.

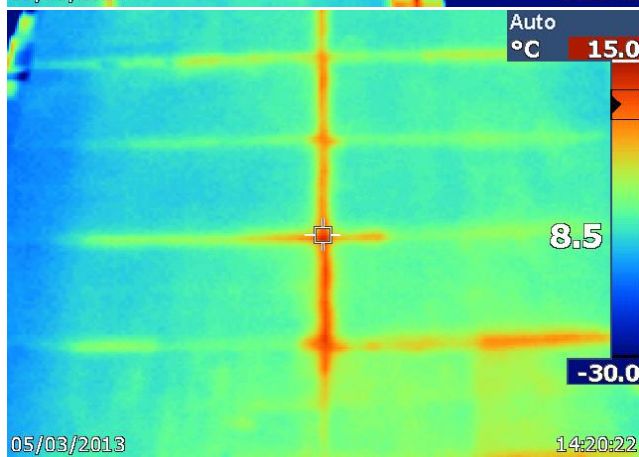


**Image 52**

Surface temperature in the measurement point: **8.5 °C**.

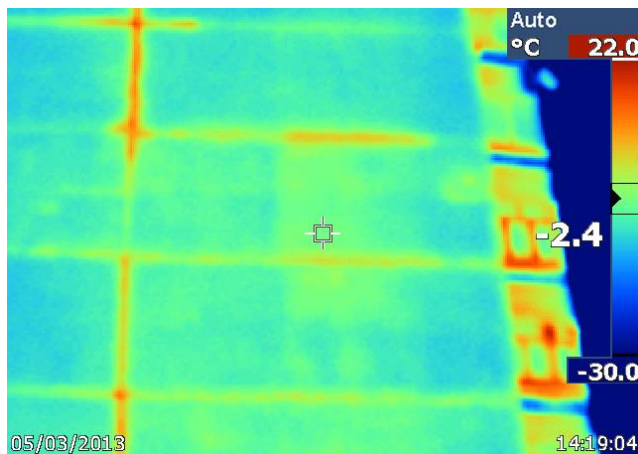


**Image 50**

Surface temperature in the measurement point: **minus 2.4 °C.**

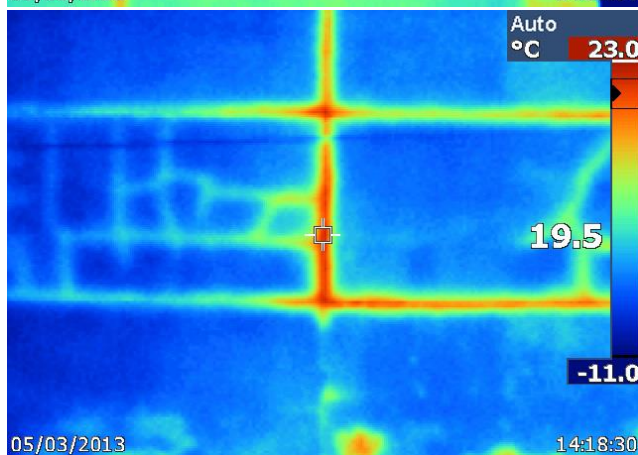

**Image 49**

Surface temperature in the measurement point: **19.5 °C.**

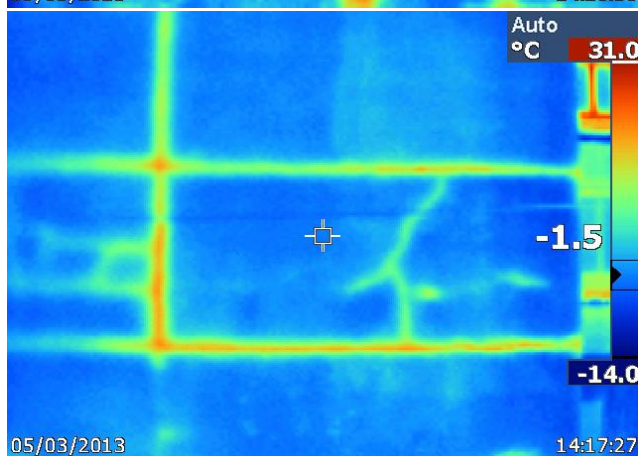

**Image 48**

Surface temperature in the measurement point: **minus 1.5 °C.**

### Enclosing structure heat transfer resistance value determination

Region	<i>The city Sergiyev Posad</i>		
Structure	<i>Plastering with cement – sand grout</i>		
		$\delta_1$	<b>0.02 m</b>
		$\lambda_1$	<b>0.93 W/m °C</b>
	<i>Haydite concrete slab <math>\gamma=800 \text{ kg/m}^3</math></i>	$\delta_2$	<b>0.32 m</b>
		$\lambda_2$	<b>0.24 W/m °C</b>
	<b>NA</b>	$\delta_4$	<b>0.00 m</b>
		$\lambda_4$	<b>1.00 W/m °C</b>
	<b>NA</b>	$\delta_4$	<b>0.00 m</b>
		$\lambda_4$	<b>1.00 W/m °C</b>
	<b>NA</b>	$\delta_5$	<b>0.00 m</b>
		$\lambda_5$	<b>1.00 W/m °C</b>
	<b>NA</b>	$\delta_6$	<b>0.00 m</b>
		$\lambda_6$	<b>1.00 W/m °C</b>

### 1. Rated heat transfer resistance of this wall

$$R_o = 1/\alpha_B + \delta_1/\lambda_1 + \delta_2/\lambda_2 + \delta_3/\lambda_3 + \delta_4/\lambda_4 + \delta_5/\lambda_5 + \delta_6/\lambda_6 + 1/\alpha_H$$

Where

$R_o$	Heat transfer resistance	1.52 m <sup>2</sup> °C/W
$\alpha_B$	Wall heat absorption coefficient SNiP II – 3- 79* table 4.	8.70 W/ m <sup>2</sup> °C
$\delta_1$	Cement – sand grout plastering	0.02 m
$\lambda_1$	Heat conductivity coefficient	0.93 W/ m <sup>2</sup> °C
$\delta_2$	Haydite concrete slab $\gamma=800 \text{ kg/m}^3$	0.32 m
$\lambda_2$	Heat conductivity coefficient	0.24 W/ m <sup>2</sup> °C
$\delta_3$	NA	0.00 m
$\lambda_3$	Heat conductivity coefficient	1.00 W/ m <sup>2</sup> °C
$\delta_4$	NA	0.00 m
$\lambda_4$	Heat conductivity coefficient	1.00 W/ m <sup>2</sup> °C
$\delta_5$	NA	0.00 m
$\lambda_5$	Heat conductivity coefficient	1.00 W/ m <sup>2</sup> °C
$\delta_6$	NA	0.00 m
$\lambda_6$	Heat conductivity coefficient	1.00 W/ m <sup>2</sup> °C
$\alpha_H$	Wall heat transfer coefficient SNiP II-3-79* table 6*	23 W/ m <sup>2</sup> °C

### 2. Estimation of heating season degree – day (HSDD).

$$\text{HSDD} = (t_B - t_{OP}) Z_{OP}$$

Where

HSDD	Heating season degree - day	5157 °C day
$t_B$	Rated indoor air temperature	21 °C
$t_{OP}$	Average heating season temperature SNiP 23-01-99 table 1	minus 3.1 °C
$Z_{OP}$	Heating season period SNiP 23-01-99 table 1	214 days

According to SNiP II-3-79\*, tables 1a and 1b. enclosing structure full heat transfer resistance shall be as follows:

Sanitary – hygienic specification:	$R_o^{TP} =$	1.38 m <sup>2</sup> °C /W
Energy efficiency specification, phase 1	$R_o^{TP} =$	1.83 m <sup>2</sup> °C /W
Energy efficiency specification, phase 2	$R_o^{TP} =$	3.2 m <sup>2</sup> °C /W

### 3. Rated heat loss

$$q = \frac{t_B - t_H}{R_o}$$

Where

		Winter	Theoretical	
q	Heat loss	16	27	W/m <sup>2</sup>
t <sub>B</sub>	Indoor air temperature	21	21	°C
t <sub>H</sub>	Outdoor air temperature	minus 3.1	minus 20	°C
R <sub>o</sub>	Heat transfer resistance, calculation 1, item 2	1.51	1.51	m <sup>2</sup> °C/W

#### 4. Enclosing structure exterior surface temperature

$$T_B = t_B - n(t_H - t_B)/R_o \alpha_B$$

Where

		Winter	Theoretical value	Actual value (image 58)	
T <sub>B</sub>	Surface temperature	minus 1	minus 16.9	minus 11.1	°C
t <sub>H</sub>	Outdoor air temperature	minus 3.1	minus 20	minus 20	°C
n	Coefficient SNIIP II – 3-79* table 3*	1	1	1	
t <sub>B</sub>	Indoor air temperature	21	21	21	°C
R <sub>o</sub>	Heat transfer resistance (calculation 1)	1.51	1.51	0.53	m <sup>2</sup> °C/W
α <sub>B</sub>	Coefficient of heat transfer to the ambient air	8.7	8.7	8.7	W/m <sup>2</sup> °C

#### 5. Enclosing structure inner surface temperature

$$T_B = t_B - n(t_B - t_H)/R_o \alpha_B$$

Where

		Winter	Theoretical value	Actual value	
T <sub>B</sub>	Inner surface temperature	16	15	13	°C
t <sub>B</sub>	Indoor air temperature (as measured in apartment 280)	18	18	18	°C
n	Coefficient SNIIP II – 3-79* table 3*	1	1	1	
t <sub>H</sub>	Outdoor air temperature	minus 3.1	minus 20	minus 20	°C
R <sub>o</sub>	Heat transfer resistance (calculation 1)	1.51	1.51	0.90	m <sup>2</sup> °C/W
α <sub>B</sub>	Coefficient of enclosing structure heat absorption (SNIIP II – 3-79* table 4*)	8.70	8.70	8.70	W/m <sup>2</sup> °C

## SUMMARY

---

Wall exterior surface averaged temperature was applied as input for the surveyed residential apartment block enclosing structure heat transfer resistance calculation.

The measurements were made using thermal imaging survey.

Ambient air temperature was minus **20 °C** at time of the thermal imaging survey.

Wall exterior surface average temperature was minus **10.7 °C**.

1. Surveyed building enclosing structure design heat transfer resistance: **1,51 m<sup>2</sup> °C /W**.
2. Surveyed building enclosing structure actual heat transfer resistance: **0.90 m<sup>2</sup> °C /W**
3. Surveyed building enclosing structure heat transfer resistance as required by the sanitary norms: **1.38 m<sup>2</sup> °C /W**
4. Surveyed building enclosing structure heat transfer resistance as required by energy efficiency norms: **1,83 m<sup>2</sup> °C /W**.

**The surveyed building does not comply with the sanitary norms, all enclosing structures shall be winterized.**

**In addition, all inter-panel joints shall be inspected and winterized.**

## List of references .

---

SNiP 23 - 01 – 99. Construction Climatology.

SNiP 23 - 02 – 2003. Thermal Protection of Buildings.

SNiP II - 3 - 79\*. Construction Heat Engineering.

Reference Book. Thermal Insulation. STROIZDAT - 1976.

TU -5768-001-62595647-2009. Super-thing thermal insulation coating TEMP-COAT<sup>®</sup>.